

20

Dhaka Water Supply and Sewerage Authority

Tender Evaluation Report

Procuring Entity : Executive Engineer, Procurement Division-2.

Name of Tender: Procurement of Different Type HT, LT Cable for Dhaka WASA.

Invitation No.: 46.05.0000.428.07.044.23/2023-24-DPM-02, Date: 05/11/2023

Approving Authority: Managing Director, Dhaka WASA.

Submitted by : Tender Evaluation Committee-9.

Date of Submission : 15/11/2023

Table of Contents

Sl. No.	Description	Page #
1.	Cover Page for Standard Evaluation Proforma	1
2.	Table of Contents	2
3.	The Act, the Rules and others: pursuant to Rule 8(13)(b) of PPR-08	3
4.	Checklists showing the time spent at each stage of procurement pursuant to Rule 8(17) of PPR-08	6
5.	Individual Declaration of Impartiality: pursuant to Rule 8(13)(a) of PPR-08	8
6.	Collective Certification to Follow the Act, the Rules and others: pursuant to Rule 8(13)(b) of PPR-08	9
7.	Tender Evaluation Report (Summary)	10
8.	Annexure-1 : Preliminary Examination	13
9.	Annexure-2 : Technical Examination and Responsiveness	15
10.	Annexure-2A : Technical Specification Compliance Sheet	16-21
11.	Annexure-3 : Financial Evaluation	22
12.	Annexure-4 : Price comparison	23
13.	Annexure-4(a) : Negotiation Meeting Resolutions.	24
14.	Annexure-5 : Post-qualification	25

The Act, the Rules and others:
Pursuant to Rule 8(13)(b) of PPR-08

<u>Checklist</u>		
1.	Checklists showing the time spent at each stage of procurement	Pursuant to Rule 8(17) of PPR-08, Checklists showing the time spent at each stage of procurement shall be attached to the Evaluation Reports. The considerations in Rule 8(17) of PPR-08 are:
	Rule 8(17) of PPR-08	Checklists stated under Sub-rule (18) showing the time spent at each stage starting from invitation Application, Tender or Proposal shall be attached to the Evaluation Reports by the Evaluation Committee and forwarded to the officer next to whom the Evaluation Report is to be submitted in accordance with the approval process and who will have to similarly fill in the time spent at his stage in the checklists and forward it to the Approving Authority with the Evaluation Report and other necessary Documents.
	Rule 8(18) of PPR-08	The checklists mentioned in Sub-Rule (17) shall be as Part A, Part B and Part C as applicable, of Schedule IV.
<u>Individual Declaration</u>		
2.	Individual Declaration of Impartiality	Pursuant to Rule 8(13)(a) of PPR-08, each member of the Evaluation Committee shall sign individually a declaration of impartiality. The provisions in Rule 8(13)(a) of PPR-08 are:
	Rule 8(13)(a) of PPR-08	The each member of the Evaluation Committee shall - (a) sign individually a declaration of impartiality in the following manner - "I (name of the Evaluation Committee member & designation) do hereby declare and confirm that I have no business or other links to any of the competing Tenderers or Applicant";
<u>Collective Certification</u>		
3.	Collective Certification to Follow the Act, the Rules and others.	Pursuant to Rule 8(13)(b) of PPR-08, each member of the Evaluation Committee shall sign collectively in the Tender or Proposal Evaluation Report by certifying a prescribed statement. The provisions in Rule 8(13)(b) are:
	Rule 8(13)(b) of PPR-08	The each member of the Evaluation Committee shall - (b) sign collectively in the Tender or Proposal Evaluation Report, by certifying that - "The Evaluation Committee certifies that the examination and evaluation has followed the requirements of the Act, the Rules made there under and the terms and conditions of the prescribed Application, Tender or Proposal Document and that all facts and information have been correctly reflected in the Evaluation Report and, that no substantial or important information has been omitted".
<u>Preliminary examination</u>		
4.	Preliminary examination Procedure	Pursuant to ITT Clause 47, preliminary examination has been carried out by TEC-9 The considerations in ITT Clause 47 are:
	ITT Clause 47.1	The TEC shall firstly examine the Tenders to confirm that all documentation requested in ITT Clause 21 has been provided. Examination of the compliance, adequacy and authenticity of the documentary evidence.
	ITT Clause 47.2	The TEC shall confirm that the above documents and information have been provided in the Tender and the completeness of the documents and compliance of instructions given in corresponding ITT Clauses shall be verified, failing which the tender shall be considered as non-responsive.

Technical examination		
5.	Technical examination Procedure	Pursuant to ITT Clause 48, Technical examination has been carried out by TEC-9 The considerations in ITT Clause 48 are:
	ITT Clause 48.1	Only those Tenders surviving preliminary examination need to be examined in this phase.
	ITT Clause 48.6	TEC will examine the adequacy and authenticity of the documentary evidence which may follow the order below:
		(a) verification of the completeness of the country of origin declaration in the Price Schedule for Goods and related services (Form PG3-4A and 4B) to determine the eligibility of the Goods and related services. (b) verification and examination of the documentary evidence and completed Specification Submission Sheet (Form PG3-5) to determine the conformity of the Goods and related services. (c) verification and examination of the documentary evidence that the Tenderer's qualifications conform to the Tender Document and the Tenderer meets each of the qualification criterion specified in Sub Section C, Qualification Criteria.
	ITT Clause 48.7	Provided that a Tender is responsive, TEC may request that the Tenderer submit the necessary information or documentation, within a reasonable period of time, to rectify nonmaterial nonconformities or omissions in the Tender related to documentation requirements. Such omission shall not be related to any aspect of the rates of the Tender reflected in the completed Price Schedule or any mandatory criteria. Failure of the Tenderer to comply with the request may result in the consideration of its Tender as non-responsive.
Financial Evaluation		
6.	Financial Evaluation Procedure	Pursuant to ITT Clause 52, Financial Evaluation has been carried out by TEC-9 . The considerations in ITT Clause 52 are:
	ITT Clause 52.1	Thirdly the TEC, pursuant to Rule 98 of the Public Procurement Rules, 2008, will evaluate each Tender that has been determined, up to this stage of the evaluation, to be responsive to the mandatory requirements set out in the Tender Document;
	ITT Clause 52.2	To evaluate a Tender, TEC will consider the following:
		(a) Tender price for Item(s) or Lot (b) adjustment for correction of arithmetical errors as stated under ITT Sub Clause 51.2; (c) adjustment for application of the methodology for determining the equivalent lot value, as stated under ITT Sub Clause 23.8, if any; (d) adjustment for application of the economic factors, as stated under ITT Sub Clause 52.6, if any; (e) adjustment in order to take into consideration the unconditional discounts and methodology for application of the discount offered for being awarded more than one lot, as stated under ITT Sub Clauses 24.11 and 24.12, if any.

Price Comparison

7.	Price Comparison Procedure	Pursuant to ITT Clause 54, Price Comparison has been carried out by TEC-9 . The considerations in ITT Clause 54 are:
	ITT Clause 54.1	TEC shall compare all responsive Tenders to determine the lowest-evaluated Tender, as stated under ITT Clause 52.
	ITT Clause 54.2	In the extremely unlikely event that there is a tie for the lowest evaluated price, the Tenderer with the superior past performance with the Procuring Entity shall be selected, whereby factors such as delivery period, quality of Goods delivered, complaints history and performance indicators could be taken into consideration.
	ITT Clause 54.3	In the event that there is a tie for the lowest price and none of the Tenderers has the record of past performance with the Procuring Entity, then the Tenderer shall be selected, subject to firm confirmation through the Post-qualification process described in ITT Clause 55, after consideration as to whether the quality of Goods that is considered more advantageous by the end-users.
	ITT Clause 54.4	The successful Tenderer as stated under ITT Sub Clauses 53.1, 53.2 and 53.3 shall not be selected through lottery under any circumstances.

CHECKLIST

Procurement Processing and Approval Procedure for Goods or Works

Procuring Entity and Description of Procurement			
1.	Ministry	Local Government, Rural Development and Co-operatives.	
	Division	Local Government division.	
2.	Agency	Dhaka Water Supply and Sewerage Authority (DWASA).	
3.	Procuring Entity	Procurement Division-2.	
4.	Name of the Project (if applicable)	Not applicable.	
5.	Source of Funds (tick relevant boxes)	☐ Government ☐ Development ☐ Revenue ☐ Project Aid ☒ Own Funds	
6.	Brief Description of Goods or Works	Procurement of Different Type HT, LT Cable for Dhaka WASA.	
7.	Procurement Method	Direct Procurement Method (DPM).	

Schedule of Activities				
Sl. No.	Activity (if not applicable indicate N/A)	Planned Date (as per flow chart)	Actual Date	If any delay Indicate No. of days
A	Prequalification:			
	A1, A2, A3, A4 or A5	Not Applicable		
B	Tender for Goods			
B1	Date of advertisement of Invitation for Tenders	Not Applicable	Not Applicable	
B2	Date of Issue of Tender Document (If different from B1 above)		05/11/2023	
B3	Date of Pre-Tender meeting	Not applicable	Not applicable	
B4	Date of Submission of Tenders	12/11/2023	12/11/2023	
B5	Date of Opening of Tenders (If different from B4)	12/11/2023	12/11/2023	
B6	Date of Submission of Technical Sub-Committee Report, where applicable	Not Applicable	Not Applicable	
B7	Date of submission of Evaluation Report			
B8	Date of Approval for Award of Contract			

[Signature]
15/11/23

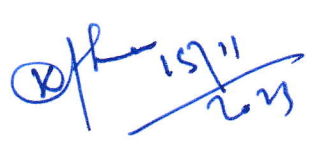
[Signature]
15.11.23

[Signature]
15.11.23





[Signature]
15.11.2023

[Signature]
15/11/23

Checklists showing the time spent at each stage of procurement (Cont.)
Procurement of Different Type HT, LT Cable for Dhaka WASA
Tender No. 46.05.0000.428.07.044.23/2023-24-DPM-02, Date 05/11/2023

Schedule of Activities in PPPAP Process				
Date of Submission of Tender Evaluation Report to the Approving Authority	Planned Date (as per flow chart)		Actual Date	Delay (In days)
Superintending Engineer	Received			
	Approved/Reviewed			
	Forwarded			
Head of Department/Directorate Head/Chief Executive of a - Corporation - Autonomous Body (Managing Director) - Semi-Autonomous Body	Received			
	Approved/Reviewed			
	Forwarded			
Board of Directors (Dhaka WASA Board)	Received			
	Approved/Reviewed			
	Forwarded			
Ministry/Division	Received			
	Approved/Reviewed			
	Forwarded			
CCGP	Received			
	Approved/Reviewed			
	Forwarded			
Date of Issue of the Notification of Award (NOA) for Goods or Works				
Signature of Chairperson of Tender Evaluation Committee-9 (TEC-9)				
Name and Designation of Chairperson of Tender Evaluation Committee-9 (TEC-9)	Md. Kamrul Hasan Chief Engineer, and Chairman of TEC-9, Dhaka WASA			

Individual Declaration of Impartiality
Procurement of Different Type HT, LT Cable for Dhaka WASA
Tender No. 46.05.0000.428.07.044.23/2023-24-DPM-02, Date 05/11/2023


"I, Md. Jayanal Abdin, Member-Secretary of TEC-9, do hereby declare and confirm that I have no business or other links to any of the competing Tenderers or Applicant"  15/11/23	"I, Md. Tawfiqul Islam, Member of TEC-9, do hereby declare and confirm that I have no business or other links to any of the competing Tenderers or Applicant"  15.11.23
"I, Noruzzaman Maingee, Member of TEC-9, do hereby declare and confirm that I have no business or other links to any of the competing Tenderers or Applicant"  15.11.23	"I, Md. Anisur Rahman Patwary, Member of TEC-9, do hereby declare and confirm that I have no business or other links to any of the competing Tenderers or Applicant"  15.11.23
	"I, Md. Kamrul Hasan Chairman of TEC-9, do hereby declare and confirm that I have no business or other links to any of the competing Tenderers or Applicant"  15/11/23

Collective Certification to Follow the Act, the Rules and others

Procurement of Different Type HT, LT Cable for Dhaka WASA.

Tender No. 46.05.0000.428.07.044.23/2023-24-DPM-02, Date 05/11/2023


"The Evaluation Committee certifies that the examination and evaluation has followed the requirements of the Act, the Rules made there under and the terms and conditions of the prescribed Application, Tender or Proposal Document and that all facts and information have been correctly reflected in the Evaluation Report and, that no substantial or important information has been omitted".




Md. Jayanal Abdin
Executive Engineer
Procurement Division-2
and Member-Secretary of TEC-9,
Dhaka WASA



Noruzzaman Maingee
Deputy-Secretary,
Administration Division-2, Dhaka
WASA and Member of TEC-9,
Dhaka WASA



Md. Anisur Rahman Patwary
Deputy-Chief Finance Officer,
Dhaka WASA and Member of
TEC-9, Dhaka WASA



Towfiqul Islam
Project Director STN Project,
BTCL, Post and Telecom
Division and Member of TEC-9,
Dhaka WASA



Md. Kamrul Hasan
Chief Engineer,
and
Chairman of TEC-9, Dhaka WASA

Tender Evaluation Report (DPM)

Summary

A. General Information: (Select the appropriate options in the box shown)		
1.	Procuring Entity Name	Executive Engineer, Procurement Division-2, Dhaka WASA.
2.	Name of Tender	Procurement of Different Type HT, LT Cable for Dhaka WASA
3.	Invitation for	Goods in a single Lot
4.	Invitation reference	46.05.0000.428.07.044.23/2023-24-DPM-02, Date 05/11/2023
5.	Tendering Method	Direct Procurement Method (DPM)
6.	Tender Document Preparation	Pursuant to Rule 4(1) of PPR-08, Tender Document has been prepared using STD PG3 issued by CPTU.
7.	Official Estimate	Tk. 99,92,975.00(Ninety Nine Lac Ninety Two Thousand Nine Hundred Seventy Five) only.
B. Approval Information:		
8.	Approval of Annual Procurement Plan	Approved APP for the FY 2023-24.
9.	Approval of Tendering Method	Direct Procurement Method.
10.	Approval of Budget and Source of Funds	Approved by HOPE
11.	Approval of Official Estimate	In accordance with the Delegation of Financial Powers (DoFP), Official Estimate has been approved by Managing Director, Dhaka WASA.
C. Advertisement Information:		
12.	Published in daily Newspaper/website of DWASA/CPTU/Others	Not required for Direct Procurement Method (DPM).
D. Tender Opening Information:		
13.	Tender opened on	12/11/2023 at 13.00 P.M.
14.	Preparation of Tender Opening Sheet (TOS)	Pursuant to ITT Clause 16 of tender document and Rule 97(4) of PPR-08, the Tender Opening Committee (TOC) formed by TEC-9 opened the Tenders received by the Procuring Entity and prepared Tender Opening Sheet (TOS).
E. Tender Evaluation Information:		
15.	Tender evaluated on	15/11/2023
16.	Tender Evaluated by	The Tenders received by Procuring Entity were evaluated by Tender Evaluation Committee-9 (TEC-9) formed vide memo no. S-Dev/W-367/08/Vol-2/121/Admin-2, 15/04/09

[Signature]
15/11/23

[Signature]
15.11.23

[Signature]
15.11.23

[Signature]
15.11.23

[Signature]
15/11/23

Tender Evaluation Report (DPM) (Cont.)

Procurement of Different Type HT, LT Cable for Dhaka WASA
Tender No. 46.05.0000.428.07.044.23/2023-24-DPM-02, Date 05/11/2023

F. Tender Evaluation Procedure:		
17.	Evaluation Procedure	The Tender Evaluation Committee-9 (TEC-9) has examined the Tenders pursuant to ITT Clause 44.1 and Rule-28 of PPR-08: Evaluation of Tenders. The considerations in ITT Clause 44.1 are:
	ITT Clause 17.1	The Tender Evaluation Committee (TEC) may consider a Tender as responsive in the Evaluation, only if it is submitted in compliance with the mandatory requirements set out in the Tender Document. The evaluation process should begin immediately after tender opening following four steps: (a) Preliminary examination; (b) Technical examination and responsiveness; (c) Financial evaluation and price comparison; (d) Post-qualification of the lowest evaluated responsive Tender.
18.	Preliminary examination	Pursuant to ITT Clause 47, preliminary examination has been carried out and the details are attached in Annexure-1.
18.1	Observations in preliminary examination stage	- TEC-9 has examined one Tender received by the Procuring Entity and opened by the Tender Opening Committee (TOC). - one Tenders are being considered as responsive in this stage of examination.
19.	Technical Examination and Responsiveness	Pursuant to ITT Clause 48, technical examination and responsiveness has been carried out and the details are attached in Annexure-2.
19.1	Observations in Technical Examination and Responsiveness stage	- TEC-9 has examined one Tender being considered responsive in the preliminary examination stage. - The requirements in regards to scope of supply as stated under Section 6: Schedule of Requirements with completed Specification Submission & Compliance Sheet (Form PG3-4) has been verified to establish the conformity of the Goods and Related Services to the Tender Documents and the findings are attached in annexure-2A - one Tender is being considered as responsive in this stage of examination.
20.	Financial Evaluation	Pursuant to ITT Clause 52, financial evaluation has been carried out and the details are attached in Annexure-3.
20.1	Observations in Financial Evaluation stage	- TEC-9 has evaluated one Tender being considered responsive in the Technical examination stage. - One tender is being considered as responsive in this stage of examination
21.	Price Comparison	Pursuant to ITT Clause 54, price comparison has been carried out and the details are attached in Annexure-4.
21.1	Observations in Price Comparison stage	- TEC-9 has evaluated 1 numbers of Tenders being considered responsive in the Financial Evaluation stage. - In this stage of evaluation, the Tenderer Eastern Cables Limited became the lowest Evaluated Responsive Tenderer, the Tender Price of which is Tk. Tk. 99,92,975.00 (Ninety Nine Lac Ninety Two Thousand Nine Hundred Seventy Five) only.
22	Negotiation	Pursuant to Rules 75(3) PPR-2008.
22.1	Observations in negotiation stage	Carried out and the details are attached in Annexure 4/A
23.	Post-qualification of the Lowest Evaluated Responsive Tender	Pursuant to ITT Clause 56, post-qualification of the lowest Evaluated Responsive Tenderer has been carried out and the details are attached in Annexure-5.
23.1	Observations in post qualification stage	Pursuant to Rule 100 of PPR-08, after analysing/verifying the requirements specified in the Tender Document, TEC-9 determined to its satisfaction that the lowest Evaluated Tenderer Eastern Cables Limited is qualified to perform the Contract satisfactorily.


Auth
15.11.2023

K 15/11/23

Tender Evaluation Report (DPM) (Cont.)

Procurement of Different Type HT, LT Cable for Dhaka WASA
Tender No. 46.05.0000.428.07.044.23/2023-24-DPM-02, Date 05/11/2023

24	Recommendations	TEC-9 recommends to accept the Tender of Eastern Cables Limited Negotiated Tender Price of which is Tk. 99,92,975.00(Ninety Nine Lac Ninety Two Thousand Nine Hundred Seventy Five) Only.
25.	Submission	Submitted to the approving authority.



Md. Jayanal Abdin
Executive Engineer
Procurement Division-2
and Member-Secretary of TEC-9,
Dhaka WASA



Noruzzaman Maingee
Deputy-Secretary,
Administration Division-2, Dhaka
WASA and Member of TEC-9,
Dhaka WASA



Md. Anisur Rahman Patwary
Deputy-Chief Finance Officer,
Dhaka WASA and Member of
TEC-9, Dhaka WASA



Towfiqul Islam
Project Director STN Project, BTCL,
Post and Telecom Division and
Member of TEC-9, Dhaka WASA



Md. Kamrul Hasan
Chief Engineer,
and
Chairman of TEC-9, Dhaka WASA

Preliminary ExaminationProcurement of Different Type HT, LT Cable for Dhaka WASATender No. 46.05.0000.428.07.044.23/2023-24-DPM-02, Date 08/12/2021

ITT Clause	Clause Description	Eastern Cables Limited
(1)	(2)	(3)
21.1	The Tender prepared by the Tenderer shall comprise the following:	
21.1 (a)	the Tender Submission Letter (Form PG3-1), as stated under with ITT Sub Clause 22.1;	Submitted
21.1 (b)	the Tenderer Information as stated under ITT Clauses 5,26 and 27 (Form PG3-2);	Submitted
21.1 ©	the priced Schedule for each lot (Form PG3-4A and PG3-4B) as stated under ITT Clauses 22, 24 and 25;	Submitted
21.1 (d)	the Tender Security as stated under ITT Clause 31, 32 and 33;	Not Applicable
21.1 (e)	the completed Specifications Submission and Compliance Sheet (Form PG3-5) as stated under ITT clause 27.2;	Submitted
21.1 (f)	the alternatives, if permissible, as stated under with ITT Clause 23;	Submitted
21.1 (g)	the written confirmation authorising the signatory of the Tender to commit the Tenderer, as stated under ITT Sub Clause 36.3;	Submitted
21.1 (h)	the Valid Trade License;	Submitted
21.1 (i)	documentary evidence of Tax Identification Number (TIN) and Value Added Tax (VAT) as a proof of taxation obligations as stated under ITT Sub Clause 5.4;	Submitted
21.1 (j)	documentary evidence as stated under ITT Clause 26, 27 and 28; establishing the Tenderer's eligibility, eligibility and conformity of the Goods and related services and, the minimum qualifications of the Tenderers required to be met for due performance of the Goods and related services under the Contract;	Submitted
21.1 (k)	documents establishing legal and financial autonomy and compliance with commercial law, as stated under ITT Sub Clause 5.9 in case of government owned entity; and	Submitted
21.1 (l)	any other document as specified in the TDS .	Not Asked
ITT 29	Tender validity	OK
47.2	TEC shall confirm that the following documents and information have been provided in the tender. If any of these documents or information is missing, the offer shall be rejected;	
47.2 (a)	Tender Submission Letter;	OK
47.2 (b)	Priced Schedule;	OK
47.2©	Written confirmation authorizing the signatory of the Tender to commit the Tenderer; and	OK
47.2(d)	Valid Tender Security.	Not Applicable
	Completeness of the documents and Responsiveness	Complete & Responsive

[Signature]
15/11/23

[Signature]
15.11.23

[Signature]
15.11.23
10/11/23
15.11.2023

[Signature]
15/11/23



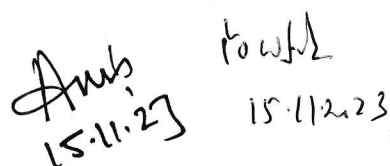
Technical Examination and Responsiveness

Procurement of Different Type HT, LT Cable for Dhaka WASA

Tender No. 46.05.0000.428.07.044.23/2023-24-DPM-02, Date 05/11/2023

Check list for Technical Examination:

ITT Clause	Clause Description	National Tubes Limited
(1)	(2)	(3)
48.6	TEC will examine the adequacy and authenticity of the documentary evidence which may follow the order below:	
48.6(a)	verification of the completeness of the country of origin declaration in the Price Schedule for Goods and related services (Form PG3-4A and PG3-4B) to determine the eligibility of the Goods and related services.	Comply
48.6(b)	verification and examination of the documentary evidence and completed Specification Submission Sheet (Form PG3-5) to determine the conformity of the Goods and related services.	Comply
48.6(c)	verification and examination of the documentary evidence that the Tenderer's qualifications conform to the Tender Document and the Tenderer meets each of the qualification criterion specified in Sub Section C, Qualification Criteria.	Comply


15/11/23
15.11.23
15.11.23

15/11/23


15/11/23

Technical Specification Compliance Sheet

Procurement of Different Type HT, LT Cable for Dhaka WASA

Tender No. 46.05.0000.428.07.044.23/2023-24-DPM-02, Date 05/11/2023




1. Technical specification of 3x70 sm/35 rm NYY LT Cable

SI. No.	Name of Parameters	Unit	Requirements in regards to Scope of Supply		Response of the Tenderer (Eastern Cable Limited)		Finding s
1	Size of Cable	no. x mm ²	3 X 70 sm/35 rm		3 X 70 sm/35 rm		Comply
			70 sm (full core)	35 rm (half core)	70 sm (full core)	35 rm(half core)	Comply
2	Type of Cable	-	NYY		NYY		Comply
3	Conductor materials	-	Plain annealed copper	Plain annealed copper	Plain annealed copper	Plain annealed copper	Comply
4	No of strand and dia. of wires	mm	20 X 2.17	19 X 1.53	20 X 2.17	19 X 1.53	Comply
5	Dia. of stranded conductor	mm	9.8/13.0	7.65	9.8/13.0	7.65	Comply
6	Insulation thickness	mm	1.40	1.20	1.40	1.20	Comply
7	Dia. of insulated conductor	mm	12.6/15.8	10.05	12.6/15.8	10.05	Comply
8	Colour of insulation		Red, Yellow & Blue	Black	Red, Yellow & Blue	Black	Comply
9	Max. Resistance at 30°C	Ω per Km	0.268	0.524	0.268	0.524	Comply
10	Core stranded dia.	mm	27.54		27.54		Comply
11	Tapping thickness	mm	0.45		0.45		Comply
12	Dia. over tapping	mm	28.44		28.44		Comply
13	Sheath thickness	mm	2.0		2.0		Comply
14	Overall dia.	mm	32.44		32.44		Comply
15	Colour of sheath	-	Black		Black		Comply
16	Insulating material	-	PVC		PVC		Comply
17	Sheath material	-	PVC		PVC		Comply
18	Approximate weight	kg/k m	2918.87		2918.87		Comply
19	Continuous permissible service voltage	V	600/1000		600/1000		Comply
20	Current rating at 35°C on Air	amps	190		190		Comply
21	Current rating at 35°C enclosed in conduit	amps	190		190		Comply

2. Technical specification of 1 X 35 rm NYY LT Cable

SI. No.	Name of Parameters	Unit	Requirements in regards to Scope of Supply	Response of the Tenderer (Eastern Cable Limited)	Findings
1	Size of Cable	no. x mm ²	1x35rm	1x35rm	Comply
2	Type of Cable	-	NYY	NYY	Comply



3	Conductor materials	-	Plain annealed copper	Plain annealed copper	Comply
4	No of strand and dia. of wires	mm	19 X 1.53	19 X 1.53	Comply
5	Dia. of stranded conductor	mm	7.65	7.65	Comply
6	Insulation thickness	mm	1.20	1.20	Comply
7	Dia. of insulated conductor	mm	10.05	10.05	Comply
8	Sheath thickness	mm	1.80	1.80	Comply
9	Overall dia.	mm	13.65	13.65	Comply
10	Colour of insulation	-	Black	Black	Comply
11	Colour of sheath	-	Black	Black	Comply
12	Insulating material	-	PVC	PVC	Comply
13	Sheath material	-	PVC	PVC	Comply
14	Approximate weight	kg/km	466.38	466.38	Comply
15	Continuous permissible service voltage	V	600/1000	600/1000	Comply
16	Current rating at 30°C ambient temperature U/G	amps	155	155	Comply
17	Current rating at 35°C ambient in Air	amps	160	160	Comply
18	Max. Resistance at 30°C	Ω/km	0.5343 Ω/km	0.5343 Ω/km	Comply

3. Technical specification of 1 X 10 rm NYY LT Cable

Sl. No.	Name of Parameters	Unite	Requirements in regards to Scope of Supply	Response of the Tenderer (Eastern Cable Limited)	Findings
1	Size of Cable	no. x mm ²	1x10rm	1x10rm	Comply
2	Type of Cable	-	NYY	NYY	Comply
3	Conductor materials	-	Plain annealed copper	Plain annealed copper	Comply
4	No of strand and dia. of wires	mm	7 X 1.35	7 X 1.35	Comply
5	Dia. of stranded conductor	mm	4.05	4.05	Comply
6	Insulation thickness	mm	1.00	1.00	Comply
7	Dia. of insulated conductor	mm	6.05	6.05	Comply
8	Sheath thickness	mm	1.80	1.80	Comply
9	Overall dia.	mm	9.65	9.65	Comply
10	Colour of insulation	-	Red, Yellow, Blue, Black	Red, Yellow, Blue, Black	Comply
11	Colour of sheath	-	Black	Black	Comply
12	Insulating material	-	PVC	PVC	Comply
13	Sheath material	-	PVC	PVC	Comply
14	Approximate weight	kg/km	182	182	Comply
15	Continuous permissible service voltage	V	600/1000	600/1000	Comply
16	Current rating at 30°C ambient temperature U/G	amps	78	78	Comply
17	Current rating at 35°C ambient in Air	amps	69	69	Comply
18	Conductor materials	Ω/km	1.8399 Ω/km	1.8399 Ω/km	Comply

25/11/23

15.11.23

15.11.23

15.11.2023

15.11.2023

4. Technical specification of 1 X 70 rm NYY LT Cable

Sl. No.	Name of Parameters	Unite	Requirements in regards to Scope of Supply	Response of the Tenderer (Eastern Cable Limited)	Findings
1	Size of Cable	no. x mm ²	1x70rm	1x70rm	Comply
2	Type of Cable	-	NYY	NYY	Comply
3	Conductor materials	-	Plain annealed copper	Plain annealed copper	Comply
4	No of strand and dia. of wires	mm	19 X 2.17	19 X 2.17	Comply
5	Dia. of stranded conductor	mm	10.85	10.85	Comply
6	Insulation thickness	mm	1.40	1.40	Comply
7	Dia. of insulated conductor	mm	13.65	13.65	Comply
8	Sheath thickness	mm	1.80	1.80	Comply
9	Overall dia.	mm	17.30	17.30	Comply
10	Colour of insulation	-	Black	Black	Comply
11	Colour of sheath	-	Black	Black	Comply
12	Insulating material	-	PVC	PVC	Comply
13	Sheath material	-	PVC	PVC	Comply
14	Approximate weight	kg/km	858	858	Comply
15	Continuous permissible service voltage	V	600/1000	600/1000	Comply
16	Current rating at 30°C ambient temperature U/G	amps	225	225	Comply
17	Current rating at 35°C ambient in Air	amps	245	245	Comply
18	Max. Resistance at 30°C	Ω/km	0.2723 Ω/km	0.2723 Ω/km	Comply

5. Technical specification of 1 X1.5 rm BYA Cable

Sl. No.	Name of Parameters	Unite	Requirements in regards to Scope of Supply	Response of the Tenderer (Eastern Cable Limited)	Finding s
1	Size of Cable	no. x mm ²	1x1.5rm	1x1.5rm	Comply
2	Type of Cable	-	BYA	BYA	Comply
3	Conductor materials	-	Plain annealed copper	Plain annealed copper	Comply
4	No of strand and dia. of wires	mm	7 X 0.53	7 X 0.53	Comply
5	Dia. of stranded conductor	mm	1.59	1.59	Comply
6	Insulation thickness	mm	0.70	0.70	Comply
7	Overall dia.	mm	2.99	2.99	Comply
8	Colour of insulation	-	Red/Yellow/Blue/Black/Green	Red/Yellow/Blue/Black/Green	Comply
9	Insulating material	-	PVC	PVC	Comply
10	Approximate weight	kg/km	22	22	Comply
11	Continuous permissible service voltage	V	450/750	450/750	Comply
12	Current rating at 30°C ambient temperature U/G	amps	16	16	Comply
13	Current rating at 35°C ambient in Air	amps	20	20	Comply
14	Max. Resistance at 30°C	Ω/km	11.900Ω/km	11.900Ω/km	Comply

27/11/23

Am

Am

10/11/23

PK

6. Technical specification of 1 X16 rm BYA Cable

Sl. No.	Name of Parameters	Unite	Requirements in regards to Scope of Supply	Response of the Tenderer (Eastern Cable Limited)	Findings
1	Size of Cable	no. x mm ²	1x165rm	1x16rm	Comply
2	Type of Cable	-	BYA	BYA	Comply
3	Conductor materials	-	Plain annealed copper	Plain annealed copper	Comply
4	No of strand and dia. of wires	mm	7x1.71	7x1.71	Comply
5	Dia. of stranded conductor	mm	5.23	5.23	Comply
6	Insulation thickness	mm	1.0	1.0	Comply
7	Overall dia.	mm	7.23	7.23	Comply
8	Colour of insulation	-	Green	Green	Comply
9	Insulating material	-	PVC	PVC	Comply
10	Approximate weight	kg/km	178.12	178.12	Comply
11	Continuous permissible service voltage	V	450/750	450/750	Comply
12	Current rating at 30°C ambient temperature U/G	amps	70	70	Comply
13	Current rating at 35°C ambient in Air	amps	85	85	Comply
14	Max. Resistance at 30°C	Ω/km	1.120 Ω/Km	1.120 Ω/Km	Comply

7. Technical Specifications of IC- 2x2.5 rm NYY Cable

Sl. No.	Name of Parameters	Unite	Requirements in regards to Scope of Supply	Response of the Tenderer (Eastern Cable Limited)	Findings
1	Size of Cable	no. x mm ²	1C-2x2.5rm	1C-2x2.5rm	Comply
2	Type of Cable	-	NYY	NYY	Comply
3	Conductor materials	-	Plain annealed copper	Plain annealed copper	Comply
4	No of strand and dia. of wires	mm	7x0.67	7x0.67	Comply
5	Dia. of stranded conductor	mm	2.01	2.01	Comply
6	Insulation thickness	mm	0.90	0.90	Comply
7	Dia. of insulated conductor	mm	3.81	3.81	Comply
8	Colour of insulation	-	Red, Black	Red, Black	Comply
9	Core stranded dia.	mm	7.62	7.62	Comply
10	Filling thickness	mm	0.80	0.80	Comply
11	Dia. over Filling	mm	9.22	9.22	Comply
12	Sheath thickness	mm	1.80	1.80	Comply
13	Overall dia.	mm	12.82	12.82	Comply
14	Colour of sheath	-	Black	Black	Comply
15	Insulating material	-	PVC	PVC	Comply
16	Sheath material	-	PVC	PVC	Comply
17	Approximate weight	kg/km	233.49	233.49	Comply
18	Continuous permissible service voltage	V	600/1000	600/1000	Comply

Amh

Forwld

KH

19	Current rating at 30°C ambient temperature U/G	amps	34	34	Comply
20	Current rating at 35°C ambient in air	amps	27	27	Comply
21	Maximum Resistance at 30°C	Ω/km	7.5675 Ω/km	7.5675 Ω/km	Comply

8. Technical specification of 1 X2.5 rm BYA Cable

Sl. No	Name of Parameters	Unit	Requirements in regards to Scope of Supply	Response of the Tenderer (Eastern Cable Limited)	Findings
1	Size of Cable	no. x mm ²	1x2.5rm	1x2.5rm	Comply
2	Type of Cable	-	BYA	BYA	Comply
3	Conductor materials	-	Plain annealed copper	Plain annealed copper	Comply
4	No of strand and dia. of wires	mm	7 x 0.67	7 x 0.67	Comply
5	Dia. of stranded conductor	mm	2.01	2.01	Comply
6	Insulation thickness	mm	0.8	0.8	Comply
7	Overall dia.	mm	3.61	3.61	Comply
8	Colour of insulation	-	Red/Yellow/Blue /Black/Green	Red/Yellow/Blue/ Black/Green	Comply
9	Insulating material	-	PVC	PVC	Comply
10	Approximate weight	kg/km	33	33	Comply
11	Continuous permissible service voltage	V	450/750	450/750	Comply
12	Current rating at 30°C ambient temperature U/G	amps	22	22	Comply
13	Current rating at 35°C ambient in air	amps	28	28	Comply
14	Max. Resistance at 30°C	Ω/km	7.140 Ω /Km	7.140 Ω /Km	Comply

9. Technical specification of 1 X 4rm BYA Cable

Sl. No	Name of Parameters	Unit	Requirements in regards to Scope of Supply	Response of the Tenderer (Eastern Cable Limited)	Findings
1	Size of Cable	no. x mm ²	1x4rm	1x4rm	Comply
2	Type of Cable	-	BYA	BYA	Comply
3	Conductor materials	-	Plain annealed copper	Plain annealed copper	Comply
4	No of strand and dia. of wires	mm	7x0.85	7x0.85	Comply
5	Dia. of stranded conductor	mm	2.55	2.55	Comply
6	Insulation thickness	mm	0.8	0.8	Comply

15/11/23


16/11/23

17/11/23


15-11-2023

16/11/23

7	Overall dia.	mm	4.15	4.15	Comply
8	Colour of insulation	-	Red/Yellow/Blue /Black/Green	Red/Yellow/Blue/ Black/Green	Comply
9	Insulating material	-	PVC	PVC	Comply
10	Approximate weight	kg/km	51	51	Comply
11	Continuous permissible service voltage	V	450/750	450/750	Comply
12	Current rating at 30°C ambient temperature U/G	amps	30	30	Comply
13	Current rating at 35°C ambient in air	amps	37	37	Comply
14	Max. Resistance at 30°C	Ω/km	4.470 Ω /Km	4.470 Ω /Km	Comply




Md. Jayanal Abidin
Executive Engineer
Procurement Division-2
and Member-Secretary of TEC-9,
Dhaka WASA


15.11.23

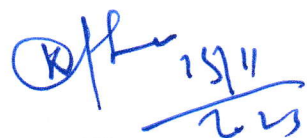
Noruzzaman Maingee
Deputy-Secretary,
Administration Division-2, and
Member of TEC-9, Dhaka WASA


15.11.23

Md. Anisur Rahman Patwary
Deputy-Chief Finance Officer, Dhaka
WASA and Member of TEC-9,
Dhaka WASA


15.11.2023

Towfiqul Islam
Project Director STN Project, BTCL, Post
and Telecom Division and Member of
TEC-9, Dhaka WASA


15/11/23

Md. Kamrul Hasan
Chief Engineer,
and
Chairman of TEC-9, Dhaka WASA

Financial Evaluation
Procurement of Different Type HT, LT Cable for Dhaka WASA
Tender No. 46.05.0000.428.07.044.23/2023-24-DPM-02, Date 05/11/2023

ITT Clause	Clause Description	Eastern Cables Limited
(1)	(2)	(3)
50.1	Acceptance for evaluation in this phase	Accepted
52.2(a)	Tender price for Item(s) or Lot	Verified
52.2(b)	adjustment for correction of arithmetical errors as stated under ITT Sub Clause 51.2;	Lot by lot
52.2(c)	adjustment for application of the methodology for determining the equivalent lot value, as stated under ITT Sub Clause 23.8, if any;	N/A
52.2(d)	adjustment for application of the economic factors, as stated under ITT Sub Clause 52.6, if any;	N/A
52.2(e)	adjustment in order to take into consideration the unconditional discounts and methodology for application of the discount offered for being awarded more than one lot, as stated under ITT Sub Clauses 24.11 and 24.12, if any.	N/A

[Signature]
15/11/23

[Signature]
15-11-23

[Signature]
15.11.23

[Signature]
15-11-2023

[Signature]

Price Comparison
Procurement of Different Type HT, LT Cable for Dhaka WASA
Tender No. 46.05.0000.428.07.044.23/2023-24-DPM-02, Date 05/11/2023.


Estimated cost Tk. 99,92,975.00

Sl. No.	Name of the responsive Tenderer	Tender Price (Tk)	Negotiated Tender price	Percent Less	As per	Percent Above	Rank
1.	Eastern Cables Limited	Tk. Tk. 99,92,975.00	Tk. 99,92,975.00	--	৳-	00	1 st lowest

1. Procurement Division-02 has initiated a tender for Procurement of Different Type HT, LT Cable for Dhaka WASA. On the basis of the requirement, Dhaka WASA.
2. Procuring Entity requested to **Eastern Cables Limited** to submit a quotation for Procurement of Different Type HT, LT Cable for Dhaka WASA and found a quotation price of **Tk. 99,92,975.00 (Ninety-Nine Lac Ninety Two Thousand Nine Hundred Seventy Five) only.**
3. Procuring Entity made an estimation for Procurement of Different Type HT, LT Cable for Dhaka WASA on the basis of quotation submitted by Eastern Cables Limited Accordingly, the file was approved by the HOPE.
4. The TEC negotiated as per PPR-2008 Rules 75 (3) with the supplier **Eastern Cables Limited** and requested to reduce the price. The supplier agreed to reduce the price and agreed to accomplish the supply of goods and related services at **Tk. 99,92,975.00(Ninety-Nine Lac Ninety Two Thousand Nine Hundred Seventy Five) Only.** However, for further negotiation, TEC requested to reduce the price some more. But the supplier did not agree to reduce the price. Therefore, the supplier's final negotiated price was **Tk. 99,92,975.00 (Ninety-Nine Lac Ninety Two Thousand Nine Hundred Seventy Five) Only.**
5. TEC finds that, to continue the water supply of Dhaka WASA fastest delivery of these goods is necessary. Therefore, the quoted price seems to be reasonable compared with early similar procurement. So, the TEC recommended to accept the tender **Eastern Cables Limited** with a value **Tk. 99,92,975.00 (Ninety-Nine Lac Ninety Two Thousand Nine Hundred Seventy Five) Only.**

Recommendation:

1. According to the above consideration the TEC-9 determined that **Eastern Cables Limited** having Tender price of **Tk. 99,92,975.00 (Ninety Nine Lac Ninety Two Thousand Nine Hundred Seventy Five) Only** is qualified to perform the contract satisfactorily.


15/11/23

Md. Jayanal Abdin
Executive Engineer
Procurement Division-2
and Member-Secretary of TEC-9,
Dhaka WASA


15.11.23

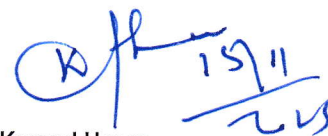
Noruzzaman Maingee
Deputy-Secretary, Administration
Division-2, Dhaka WASA and
Member of TEC-9, Dhaka WASA


15.11.23

Md. Anisur Rahman Patwary
Deputy-Chief Finance Officer, Dhaka
WASA and Member of TEC-9,
Dhaka WASA


15.11.2023

Towfiqul Islam
Project Director STN Project, BTCL, Post and
Telecom Division and Member of TEC-9,
Dhaka WASA


15/11/23

Md. Kamrul Hasan
Chief Engineer,
and
Chairman of TEC-9, Dhaka WASA

Dhaka Water Supply & Sewerage Authority
Procurement of Different Type HT, LT Cable for Dhaka WASA


1. 46.05.0000.428.07.044.23/2023-24-DPM-02, Date 05/11/2023
2. Tender Opened on: 12/11/2023; time- 13.00 PM
3. Tendering Method: Direct Procurement Method (DPM)

Negotiation Meeting Resolutions


A meeting with members of TEC and the representatives of 'Eastern Cables Limited' Held on 16/10/2022 for tender negotiation. TEC tried best to negotiate the event. The quoted price is **Tk. 99,92,975.00 (Ninety Nine Lac Ninety Two Thousand Nine Hundred Seventy Five) only** for this tender. The TEC negotiated as per PPR-2008 Rules 75 (3) with the supplier Eastern Cables Limited and requested to reduce the price. But The supplier did not agree to reduce the price. Therefore, the supplier's final negotiated Price was **Tk. 99,92,975.00 (Ninety Nine Lac Ninety Two Thousand Nine Hundred Seventy Five) only**.



Md. Jayanal Abdin
Executive Engineer
Procurement Division-2
and Member-Secretary
of TEC-9,
Dhaka WASA.


15.11.23

Noruzzaman Maingee
Deputy-Secretary,
Administration Division-
2, Dhaka WASA and
Member of TEC-9,
Dhaka WASA.


15.11.23

Md. Anisur Rahman Patwary
Deputy-Chief Finance Officer,
Dhaka WASA and Member
of TEC-9,
Dhaka WASA.


15.11.2023

Md. Tawfiqul Islam
Project Director STN
Project, BTCL, Post and
Telecom Division and
Member of TEC-9,
Dhaka WASA



15/11/23

Md. Kamrul Hasan
Chief Engineer and
Chairman of TEC-9,
Dhaka WASA.


Eastern
Cables
Limited

Post-qualification

1.	Name of Tender	Procurement of Different Type HT, LT Cable for Dhaka WASA
2.	Invitation reference	46.05.0000.428.07.044.23/2023-24-DPM-02, Date 05/11/2023
3.	Post-qualification Procedure	Pursuant to ITT Clause 56, Post-qualification has been carried out by TEC-9 . The considerations in ITT Clause 56 are:
	ITT Clause 56.1	After determining the lowest evaluated responsive Tender as stated under ITT Sub-Clause 56.1 , the TEC pursuant to Rule 100 of the Public Procurement Rules, 2008, shall carry out the Post-qualification of the Tenderer.
4.	Observations	Pursuant to Rule 100 of the PPR-08, the TEC-9 analyzed and verified all the requirements specified in the Tender Document. TEC-9 determined to its satisfaction that the Tenderer Eastern Cables Limited having Tender Price Tk. 99,92,975.00 (Ninety Nine Lac Ninety Two Thousand Nine Hundred Seventy Five Only) only is qualified to perform the contract satisfactorily.




Md. Jayanal Abdin
Executive Engineer
Procurement Division-2
and Member-Secretary of TEC-9,
Dhaka WASA



Noruzzaman Maingee
Deputy-Secretary,
Administration Division-2, Dhaka
WASA and Member of TEC-9,
Dhaka WASA



Md. Anisur Rahman Patwary
Deputy-Chief Finance Officer,
Dhaka WASA and Member of
TEC-9, Dhaka WASA



Towfiqul Islam
Project Director STN Project, BTCL,
Post and Telecom Division and
Member of TEC-9, Dhaka WASA



Md. Kamrul Hasan
Chief Engineer,
and
Chairman of TEC-9, Dhaka WASA